

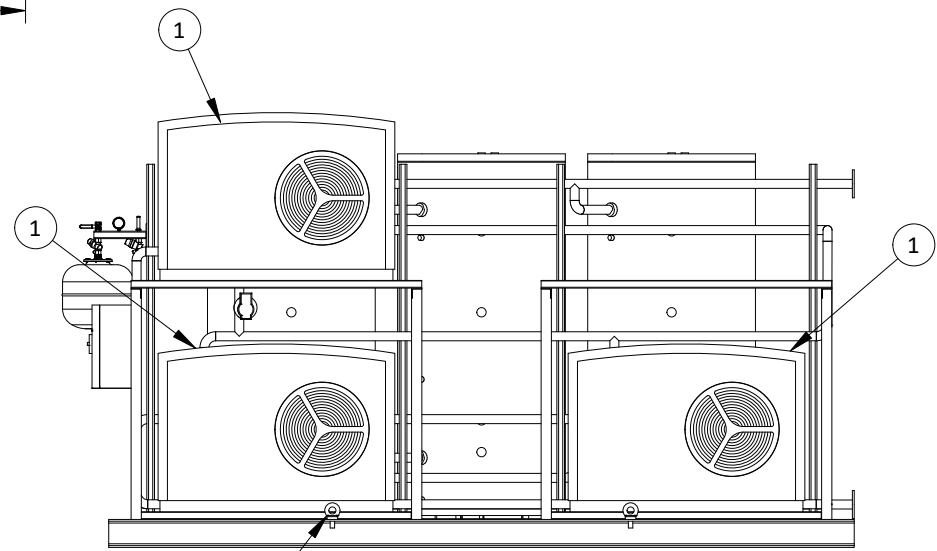


ISOMETRIC VIEW
ADDED FOR CLARITY

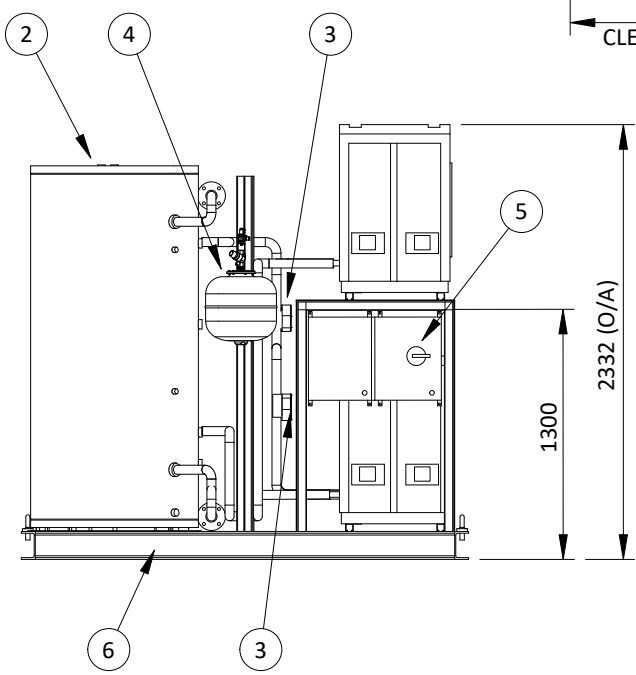


4 x LIFTING LUGS
TO AS2317

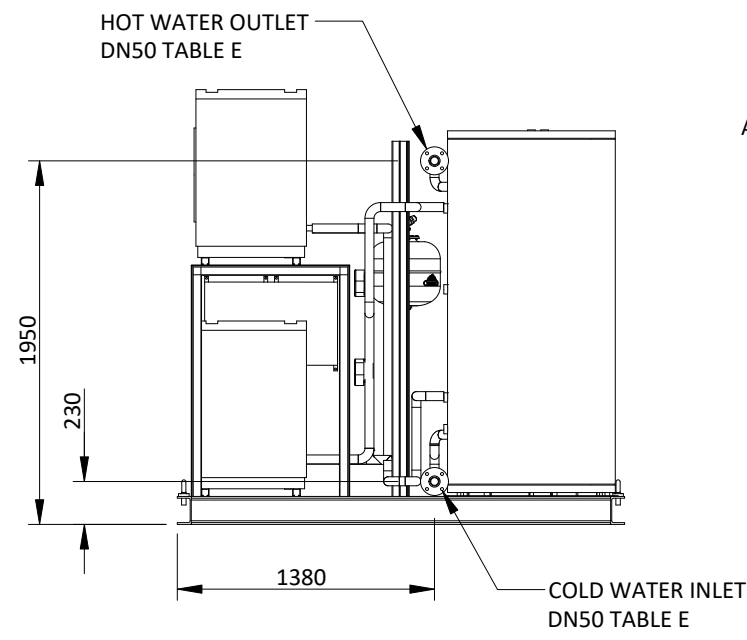

HOT WATER OUTLET
DN50 TABLE E

COLD WATER INLET
DN50 TABLE E

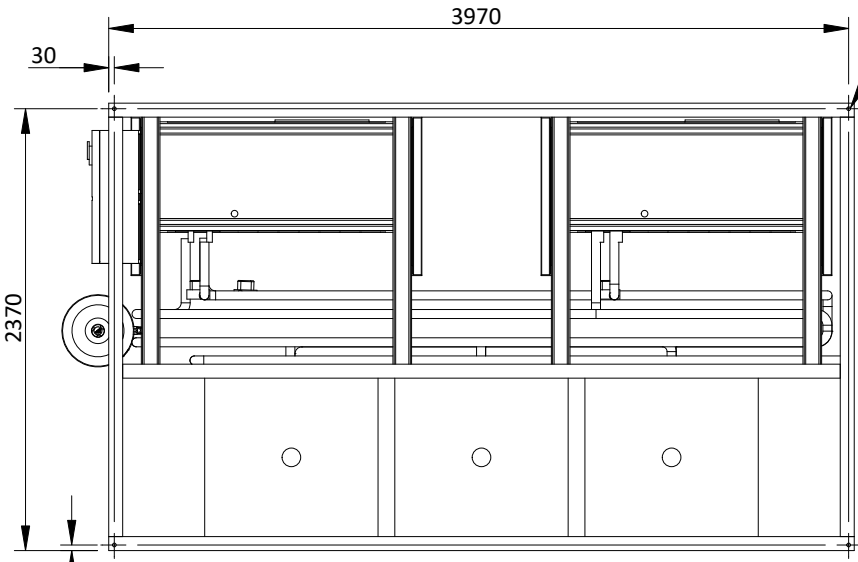

VIEW FROM BELOW

NOTES:

1. MINOR FASTENERS, SOME PIPE SUPPORTS AND INSULATION NOT SHOWN FOR CLARITY.
2. STRUCTURAL STEEL GALVANISED TO AS4680.
3. PIPING PRESSIT COPPER WITH 25mm EPDM FOIL BACKED INSULATION.
4. SKID TO BE INSTALLED ON A LEVEL SLAB. FOR ANY VARIATION IN FLOOR LEVEL SHIMS SHALL BE USED TO SUIT SKID NATURAL SHAPE.
5. RECOMMENDED 1.2m CLEARANCE ON ALL SIDES FOR SERVICE ACCESS
6. WHEN LIFTING WITH LIFT LUGS A SPREADER BAR WITH MINIMUM 2.4m WIDTH MUST BE USED TO AVOID DAMAGING THE EQUIPMENT.
7. APPROXIMATE DRY WEIGHT: 1,740 kg
APPROXIMATE WET WEIGHT: 4,670 kg

ITEM	PART No	DESCRIPTION	QTY
6		STRUCTURAL SKID FRAME	1
5		ELECTRICAL CONTROL PANEL	1
4		EXPANSION TANK AND ACCESORIES	1
3		STIEBEL ELTRON WATER PUMP	3
2		STIEBEL ELTRON OUTDOOR TANK	3
1		STIEBEL ELTRON WPL-A 07 HEAT PUMP	3

GENERAL ARRANGEMENT
DOMESTIC HOT WATER SYSTEM
CM-T 33 SKID CONFIGURATION
ARTICLE ID: 207794

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN MILLIMETERS THIRD ANGLE PROJECTION FABRICATION TOLERANCE: ± 2.0mm MACHINED TOLERANCE: ± 0.5mm			THIS DRAWING IS CONFIDENTIAL AND THE PROPERTY OF RUBIGO GROUP PTY LTD. REPRODUCTION OR DISTRIBUTION RIGHTS ARE RESERVED EXCLUSIVELY TO RUBIGO GROUP PTY LTD UNLESS OTHERWISE AGREED		
A	13/05/2025	FIRST RELEASE	JM	TS	BR
REV	DATE	DESCRIPTION	DRN	CHK	APP
1					

