

CMT-44

Commercial Modular Trend 44

Specification wording


The hot water plant shall be a closed-loop heat pump system meeting the following requirements:

The system shall consist of four (4) WPL-A 07 air-to-water monobloc outdoor heat pump units, each coupled to four (4) 829L nominal domestic hot water (DHW) coil tanks, with a total stored water volume of 3316L. The system shall provide a heating output of 36 kW at 5°C ambient air temperature with water temperatures up to 65°C directly from the tanks, without reliance on additional electric boosting. The heat pumps shall be capable of achieving flow temperatures up to 75°C and operate on R454C, a low Global Warming Potential (GWP) refrigerant. The installation can be done internal or external.

The heat pumps shall operate in a true cascade, managed by a centralised Heat Pump Manager to ensure uniform machine scheduling and optimal efficiency. The system shall be equipped with an Internet Service Gateway connected to the Heat Pump Manager and a network router/switch to enable remote service visibility and building management system (BMS) integration via MODBUS protocol.



The system shall require a connected load of 170A at 230VAC, be WaterMark certified, and be suitable for outdoor installation. Each installation shall include a 63A/PH 415V central control panel for manual selection and monitoring tank temperature, ambient air temperature, and system performance metrics. The system shall comply with all relevant Australian Standards and be configured for long-term efficiency and reliability.

Package Name	CMT-44
HP Type	WPL A-07
QTY	4
Tanks	4
Heating Cylinder Volume (L)	3316
Min. Spatial Requirement (m2)	16.92
Dry Weight (kg)	1148.00
Wet Weight (kg)	4464.00
Connected load (A)	170.00
Peak Draw (kW)	46.80
Electrical Box Sub Main (V)	63A/PH 415V

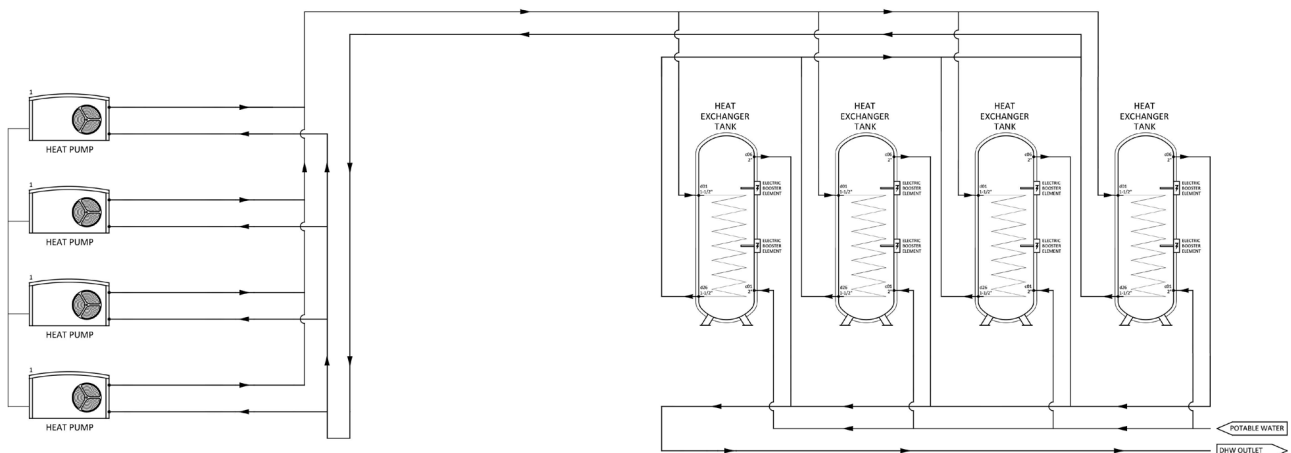


Clearances required for serviceability and system performance.

If minimum clearances can not be adhered to contact Stiebel Eltron for more information.

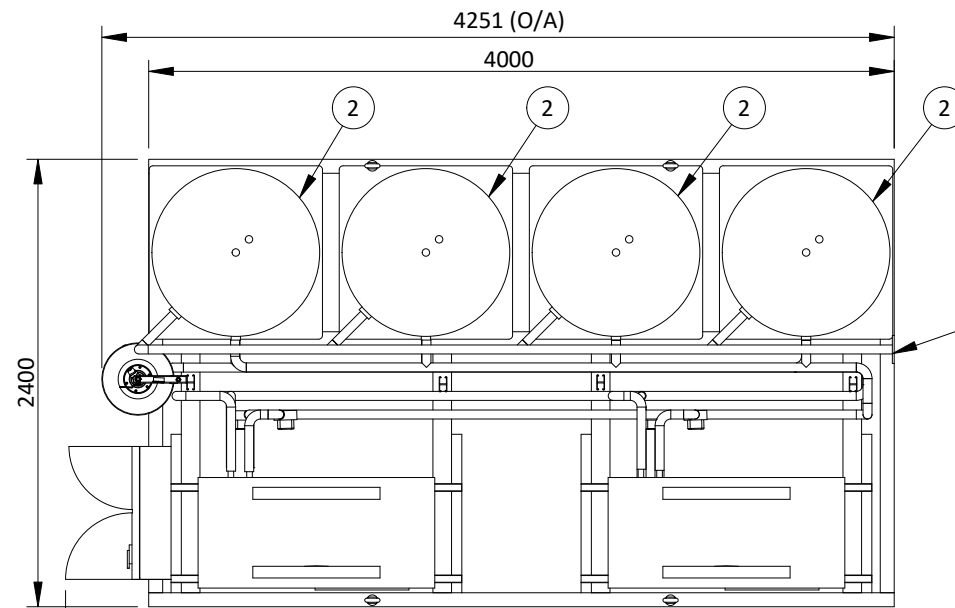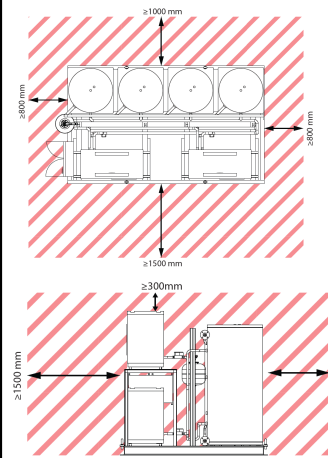


HOT & COLD WATER INLET

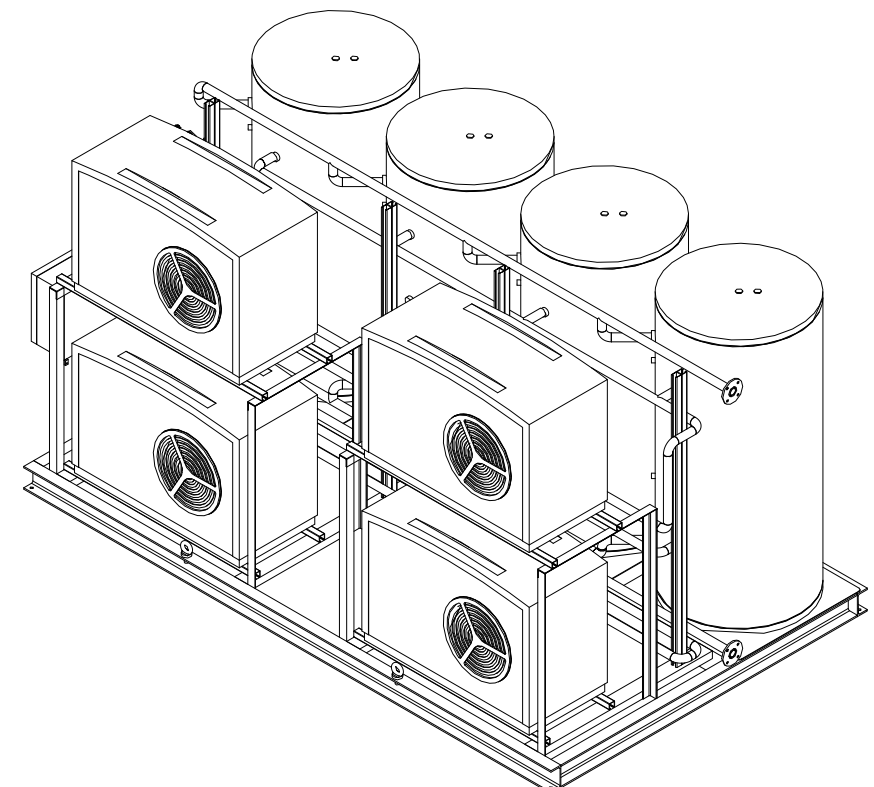


ISOMETRIC VIEW ADDED FOR CLARITY

HOT WATER OUTLET DN50 TABLE E

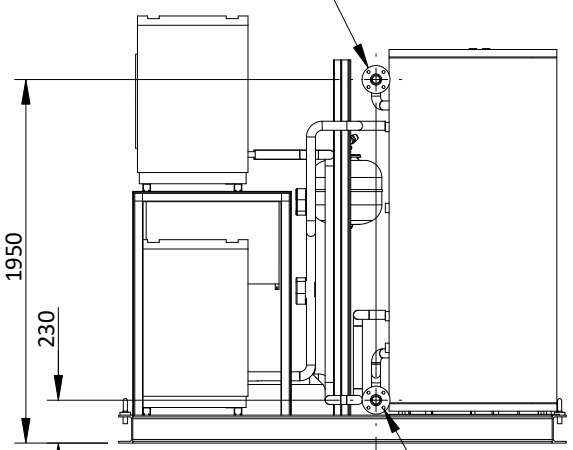


COLD WATER INLET DN50 TABLE E

1000 CLEARANCE

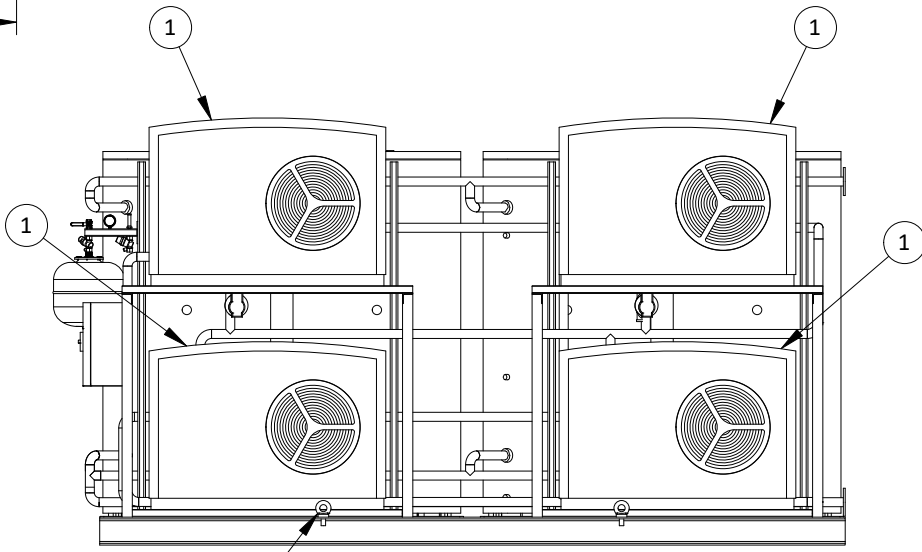

4 x LIFTING LUGS TO AS2317

4 x HOLD DOWN HOLES Ø 24 BOTTOM FLANGE ONLY

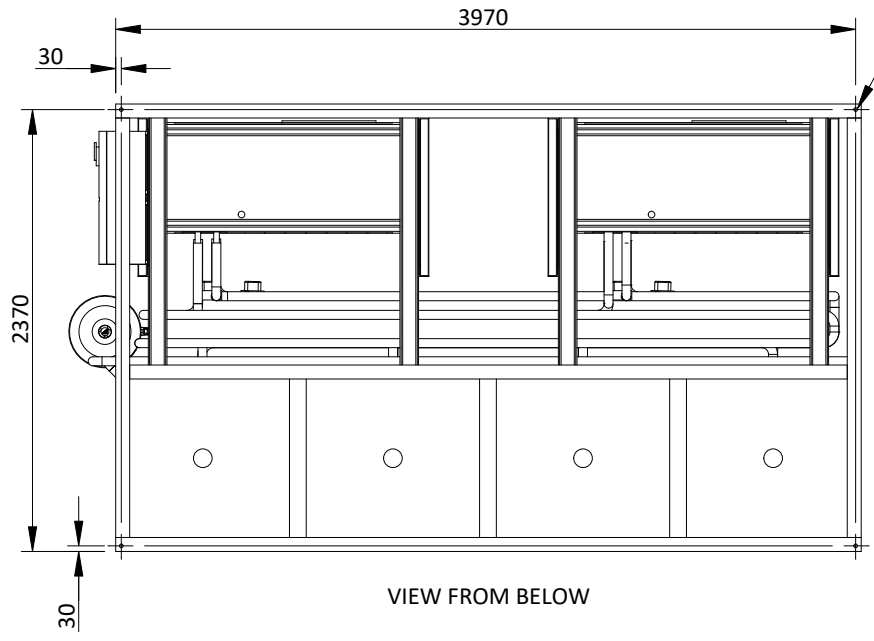

VIEW FROM BELOW

NOTES:

- MINOR FASTENERS, SOME PIPE SUPPORTS AND INSULATION NOT SHOWN FOR CLARITY.
- STRUCTURAL STEEL GALVANISED TO AS4680.
- PIPING PRESSIT COPPER WITH 25mm EPDM FOIL BACKED INSULATION.
- SKID TO BE INSTALLED ON A LEVEL SLAB. FOR ANY VARIATION IN FLOOR LEVEL SHIMS SHALL BE USED TO SUIT SKID NATURAL SHAPE.
- RECOMMENDED 1.2m CLEARANCE ON ALL SIDES FOR SERVICE ACCESS
- WHEN LIFTING WITH LIFT LUGS A SPREADER BAR WITH MINIMUM 2.4m WIDTH MUST BE USED TO AVOID DAMAGING THE EQUIPMENT.
- APPROXIMATE DRY WEIGHT: 2,130 kg
APPROXIMATE WET WEIGHT: 5,980 kg

ITEM	PART No	DESCRIPTION	QTY
6		STRUCTURAL SKID FRAME	1
5		ELECTRICAL CONTROL PANEL	1
4		EXPANSION TANK AND ACCESORIES	1
3		STIEBEL ELTRON WATER PUMP	4
2		STIEBEL ELTRON OUTDOOR TANK	4
1		STIEBEL ELTRON WPL-A 07 HEAT PUMP	4

GENERAL ARRANGEMENT
DOMESTIC HOT WATER SYSTEM
CM-T 44 SKID CONFIGURATION
ARTICLE ID: 207795

REV	DATE	DESCRIPTION	DRN	CHK	APP	SIZE: A3	SCALE: N.T.S	DO NOT SCALE DRAWING
A	13/05/2025	FIRST RELEASE	JM	TS	BR	SIZE: A3	SCALE: N.T.S	DO NOT SCALE DRAWING
						TEMPLATE: B0099-DWG-ADM-G-0001		

